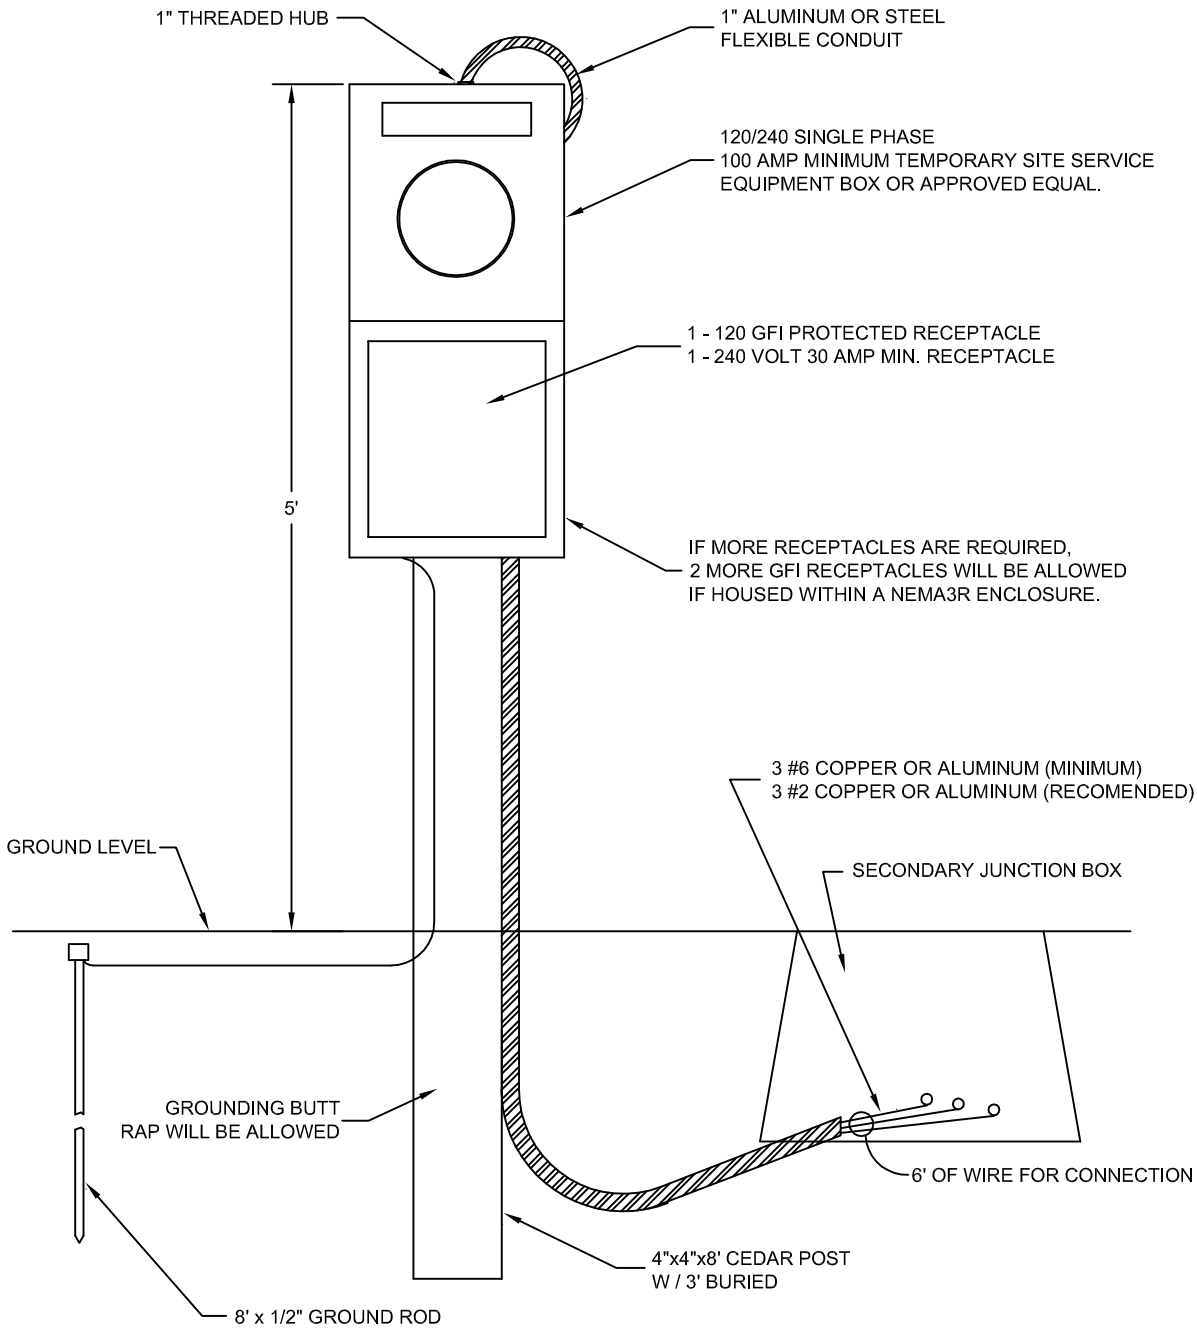

NOTES:

NO OPEN WIRES WILL BE ALLOWED.
IF THREE PHASE POWER IS REQUIRED,
ENERGY SERVICES ENGINEER APPROVAL
IS REQUIRED FOR THE METER BASE.

REVISIONS		
DATE	DESCRIPTION	BY

CITY OF ST. GEORGE
ENERGY SERVICES DEPARTMENT
UNDERGROUND STANDARDS

UNDERGROUND TEMPORARY POWER

APPROVED: D.J., R.M.

DATE: 10/01/05 | BY: J.S.

DETAIL

D7