


TRANSFORMER
GROUNDSLEEVE

PROPERTY LINE FOR ADJOINING LOT

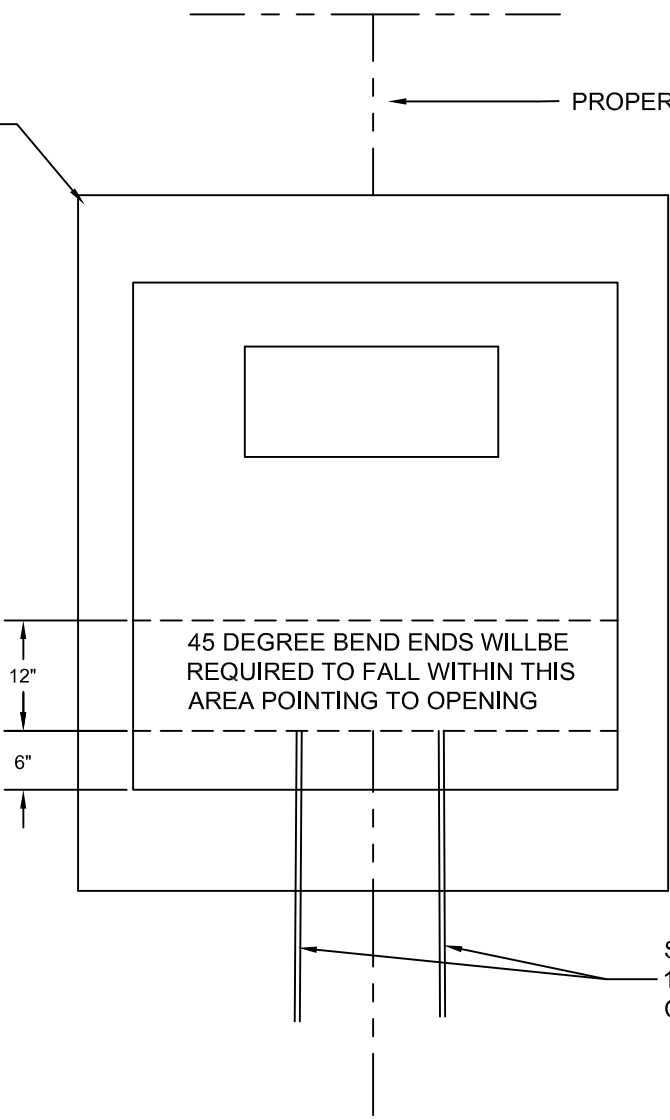

45 DEGREE BEND ENDS WILL BE
REQUIRED TO FALL WITHIN THIS
AREA POINTING TO OPENING

12"

6"

SERVICE CONDUIT
10' STUBBED OUT
CAPPED AND MARKED

REVISIONS		
DATE	DESCRIPTION	BY



CITY OF ST. GEORGE
ENERGY SERVICES DEPARTMENT
UNDERGROUND STANDARDS

ADJOINING LOT CONDUIT DETAIL
SINGLE PHASE TRANSFORMER
APPROVED: D.J., R.M.
DATE: 10/01/05 BY: J.S.

DETAIL
D18