

NEATLY INSCRIBE "S" IN CURB TO IDENTIFY WHERE SEWER LATERAL CROSSES CURB LINE

5' MIN.
10' MAX.

EXTEND PIPE CLEANOUT 2' ABOVE TOP OF CURB OR FINISHED GROUND (WHICH EVER IS HIGHER) AND CAP AND GLUE END.

BACKFILL

DEPTH VARIES

45° ELBOW (LONG SWEEP)

12"

ELBOW

2% SLOPE MIN. (SEE NOTE #3)

45° WYE


FUTURE SERVICE CONNECTION

TEMPORARY PLUG OR CAP DURING INITIAL CONSTRUCTION. (AIR TIGHT)

SELECT BEDDING 1" MINUS

INSTALL MOLDED "WYE" DURING INITIAL CONSTRUCTION.

NEW PVC PIPE

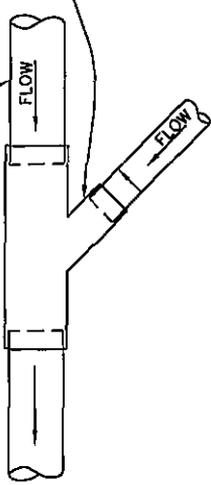

NOTES:

- 1- DURING INITIAL SEWER INSTALLATION CLEANOUT SHALL EXTEND AS SHOWN. AFTER HOME CONSTRUCTION CLEANOUT SHALL BE ADJUSTED TO GRADE.
- 2- BACKFILL AND COMPACTION REQUIREMENTS SHALL CONFORM TO CITY STANDARD SPECIFICATIONS.
- 3- 4" DIAMETER - 2% MINIMUM. 6" DIAMETER - 1% MINIMUM.
- 4- CLEANOUT DIAMETER TO BE SAME SIZE AS LATERAL.
- 5- BRASS PLUG MARKED WITH "S" PLACED IN TOP OF CURB MAY BE USED IN LIEU OF INSCRIBED "S" IN FACE.

CITY OF ST. GEORGE ENGINEERING DEPARTMENT

**P.V.C. SERVICE CONNECTION
NEW P.V.C. SEWER MAINS**

STANDARD DWG. NO.

232 | 1 OF 1

APPROVED:

DATE: | BY: LBB

| REVISIONS | | |
|-----------|-------------|----|
| DATE | DESCRIPTION | BY |
| | | |
| | | |
| | | |