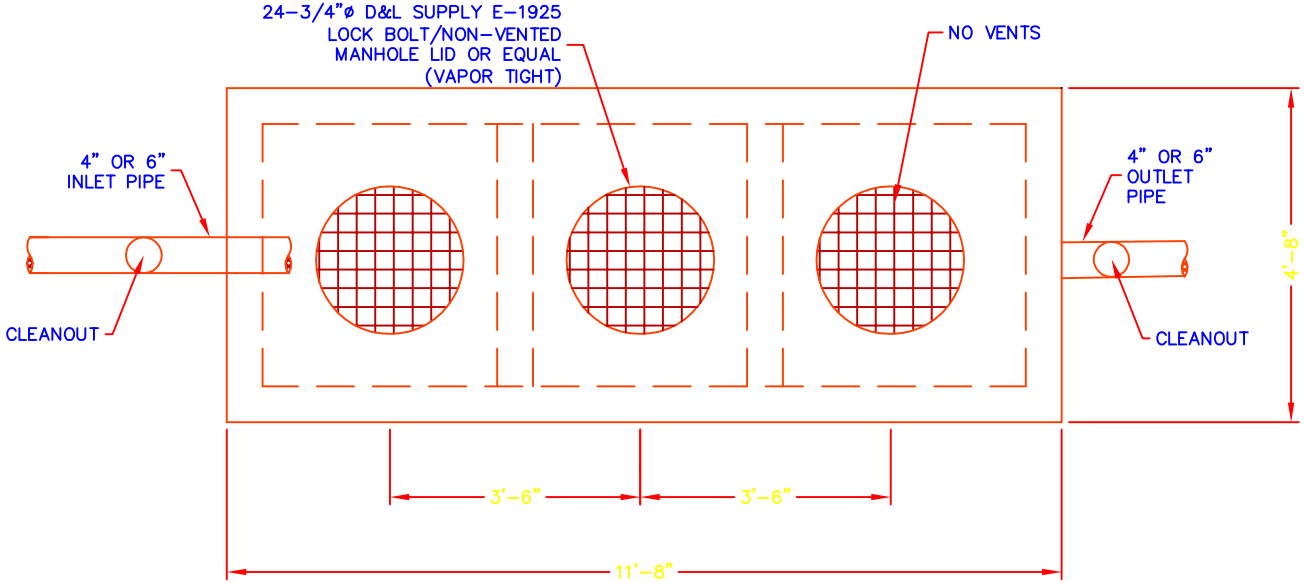

TOP VIEW

NOTES:

1. MATERIAL SPECIFICATIONS:
   1.1. CONCRETE PORTLAND CEMENT TYPE II. MINIMUM COMPRESSIVE STRENGTH=300 PSI AT 28 DAYS
   1.2. REINFORCING BAR INTERMEDIATE GRADE ASTM A615
   1.3. REINFORCING WELDED WIRE MESH ASTM A185
2. UNIT COATED OUTSIDE WITH AN APPROVED PROTECTIVE COATING
3. ALL DIMENSIONS ± NOT TO BE USED FOR CONSTRUCTION PURPOSES UNLESS CERTIFIED
4. PRECAST UNIT TO BE PLACED ON NATURAL SOIL OR APPROVED COMPACTED FILL
5. STANDARD GROUND WATER SEAL- BUTYL ROPE MASTIC OR CEMENT MORTAR
6. PRIOR TO BACKFILLING, INTERCEPTOR SHALL BE TESTED. TANK SHALL BE EXPOSED ON ALL SIDES AND FILLED WITH WATER AND SHALL HOLD WATER FOR A MINIMUM TEST PERIOD OF TWO HOURS
7. CLEANOUT SIZE TO MATCH INLET/OUTLET SIZE

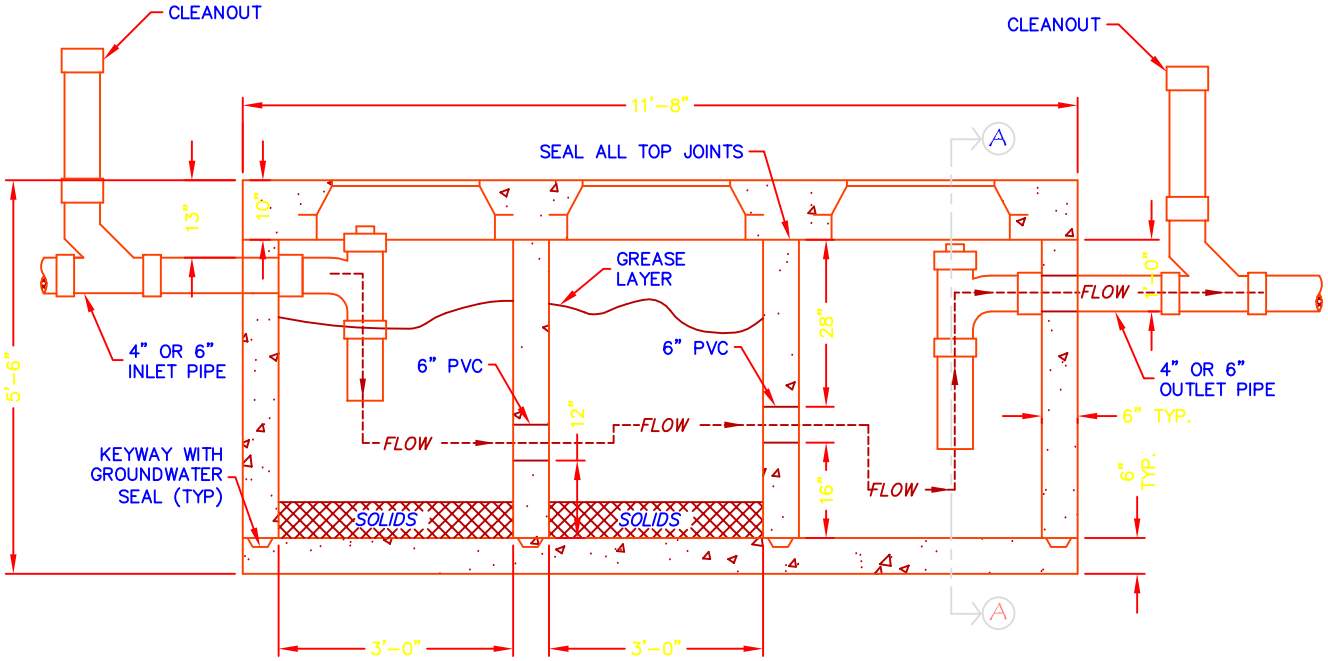

FRONT X-SECTION VIEW

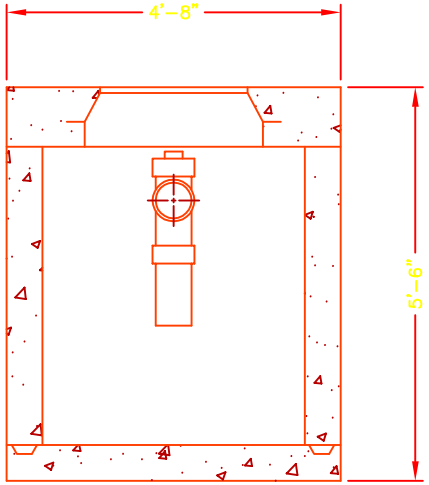

SIDE X-SECTION A-A

0
0

GREASE / SAND INTERCEPTOR

SCALE: N.T.S.

CITY OF ST. GEORGE

STANDARD DWG. NO..

234 | 1 of 1